


MAINTENANCE

⚠ CAUTION


- ⚠ Electric shock may result. Disconnect power by switching off main switch, then unplug before working on the unit. If a standby switch is connected, it is recommended to switch it off first.
- ⚠ Routine maintenance must be performed every 2 or 3 months. Clogged filters may cause condensation on the unit due to air flow reduction.
- ⚠ Please wear gloves to avoid pinching fingers during maintenance.
- ⚠ Please pay attention to dust, condensation water, or parts that may drop down when the door is opened.
- ⊘ Never use gasoline, benzene, thinner or any other such chemicals to clean the ERV.
- ⊘ Do not allow water to enter ERV.
- ⊘ Do not immerse resin parts in water over 60 °C.

- 1 Open the door by unlocking the latches.

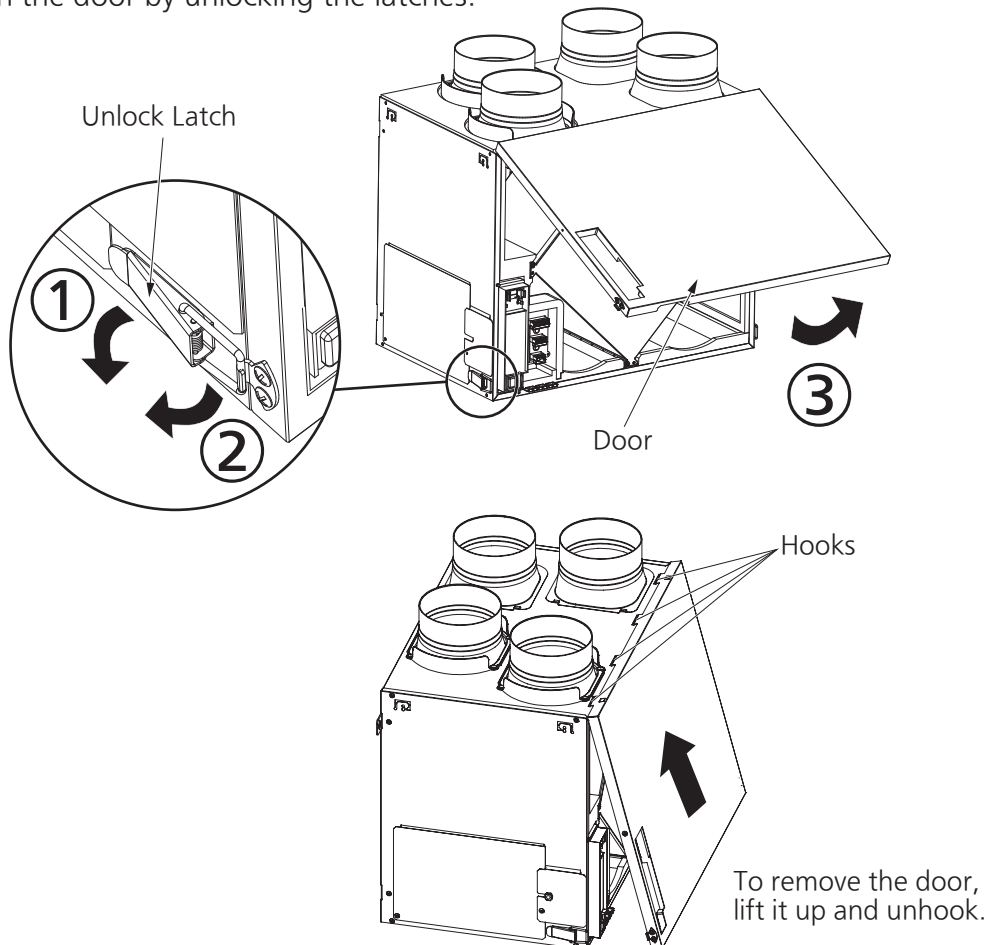


MAINTENANCE


- 2** Clean the OA filter, RA filter and energy recovery core.

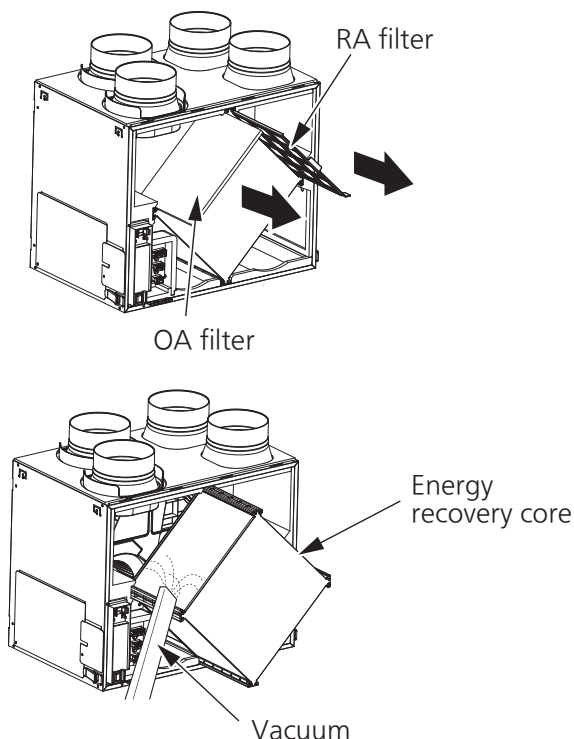

It is suggested to replace the OA filter every 6 months. Please fill in beginning time on new OA filter before replacing. Please replace OA filter by Panasonic Model FV-FL1316VE1 or FV-FL0815VE1 or FV-FL0616VE1.

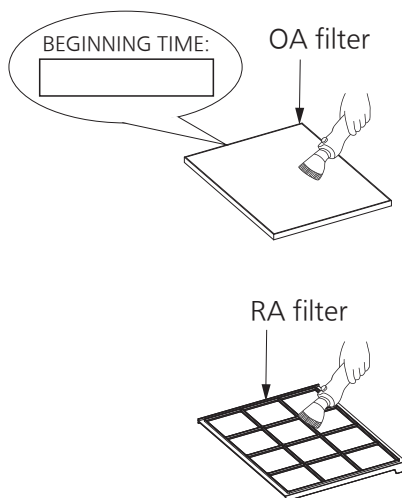


- 3** Reinstall the filters.

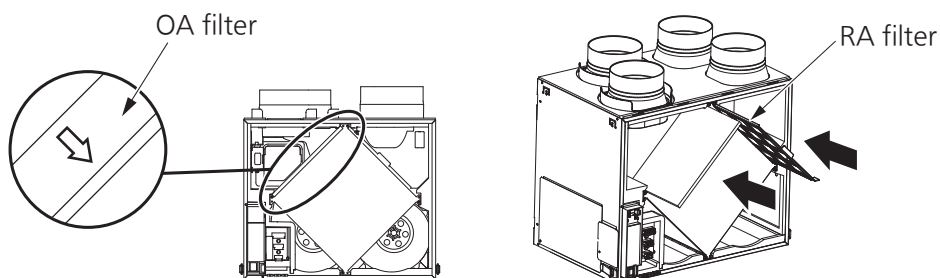

- 4** Reinstall and close door by locking the latches.

- 5** Connect power and press filter reset button. When the unit beeps, the filter reset timer will be reset.

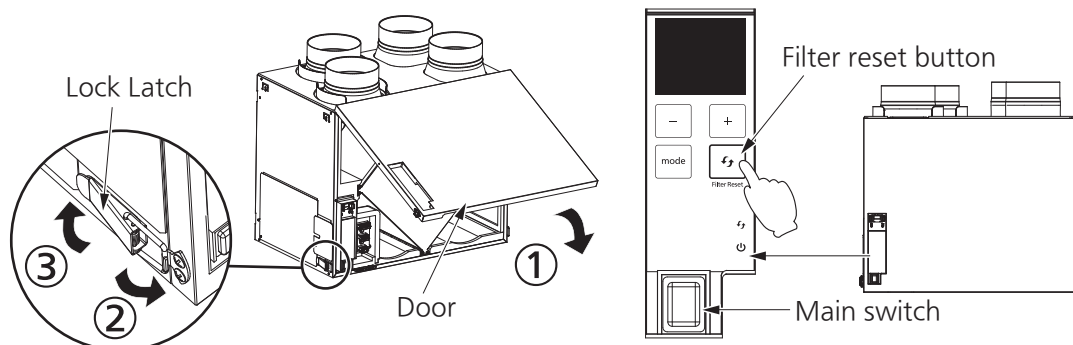

PRODUCT SERVICE

Warning Concerning Removal of Covers.

The unit should be serviced by qualified technicians only.

Your product is designed and manufactured to ensure a minimum of maintenance.

Should your unit require service or parts, call Panasonic Call Center at 1-866-292-7299 (USA) or 1-800-669-5165 (Canada).

For FV-16VEC1T/S and FV-13VEC1T/S

To ensure quiet operation of the ENERGY STAR certified ERV, each product model must be installed using sound attenuation techniques appropriate for the installation.

The way your energy-recovery ventilator is installed can make a significant difference to the electrical energy you use. To minimize the electricity use of energy-recovery ventilator, a stand-alone fully ducted installation is recommended. If you choose a simplified installation that operates your furnace air handler for room-to-room ventilation, an electrically efficient furnace that has an electronically commutated (EC) variable speed blower motor will minimize your electrical energy consumption and operating cost.

Installation of a user-accessible control with your product model will improve comfort and may significantly reduce the product model's energy use.

This product earned the ENERGY STAR® by meeting strict energy efficiency guidelines set by NaturalResources Canada and the US EPA. This product meets ENERGY STAR requirements only when used in Canada.



Panasonic Corporation of North America

Two Riverfront Plaza, Newark, NJ 07102

www.panasonic.com

Panasonic Canada Inc.

5770 Ambler Drive, Mississauga, Ontario L4W 2T3

www.panasonic.com

© Panasonic Corporation 2024-2025

Printed in Mexico
Issue date:02/2025
P0924-2025 16VC1T450B